


Elevation

End Elevation

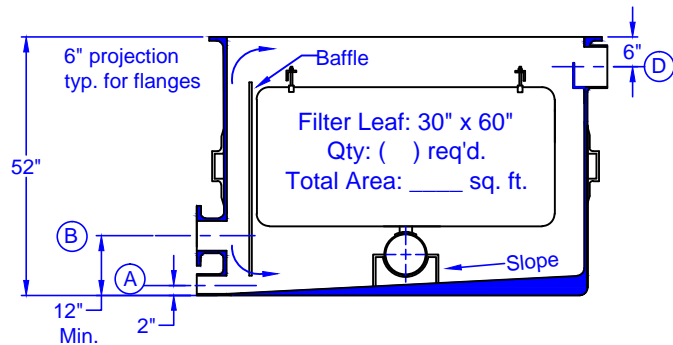

Section View

Number of Elements	Filter Area Sq. Ft.	A Drain	B Inlet	C Outlet	D Overflow	"W" Width	Weight lbs.
4	100	4"	4"	4"	4"	28"	374
5	125	4"	4"	4"	4"	33"	422
6	150	4"	6"	6"	6"	38"	458
7	175	4"	6"	6"	6"	43"	493
8	200	4"	6"	6"	6"	48"	544
9	225	4"	6"	6"	6"	53"	579
10	250	4"	6"	6"	6"	58"	613
11	275	4"	6"	6"	6"	63"	652
12	300	4"	8"	8"	8"	68"	687

GENERAL NOTES

1. Tank laminate is constructed of alternate layers of fiberglass fabric and resin and a C-glass surfacing veil.
3. Resin system shall be a corrosion grade isophthalic polyester suitable for the service conditions.
4. Construction shall be in the contact molded method in accordance to NBS PS 15-69 Product Standard.
5. Flange shall be drilled to ANSI 150 lb. standards.
6. Dimensional tolerance shall be +/- 1/8".
7. Drain and overflow connections shall be standard PVC socket weld fittings.
8. Tank requires full bottom support.
9. Flange boltholes straddle centerlines.
10. Nozzle "B" must have a minimum height of 12", otherwise it can be located vertically as desired. Nozzle "B" can also be located on 72" side of tank . Baffle must be between inlet port and filter leaves.

<p>MER-MADE FILTER PO Box 306 Denmark, SC 29042 P: 803-793-4265 F: 803-793-4332</p>		
<p>FRP Vacuum D. E. Filter Tank for 30 x 60 CBO Leaves</p>		
<p>Customer:</p>		
<p>Project:</p>	<p>Dr.By: C.S. Date: 07-22-20</p>	<p>Dwg. No. T-11373</p>